SAINT LOUIS COUNTY PROJ.	SHEET NUMBER	TOTAL SHEETS

8. For locations other than in the public road right-of-way it is recommended that the ½" Preformed Fiber Expansion Joint Filler be placed at the first joint location from the street edge.

RESIDENTIAL ENTRANCE WITH ROLLED CURB

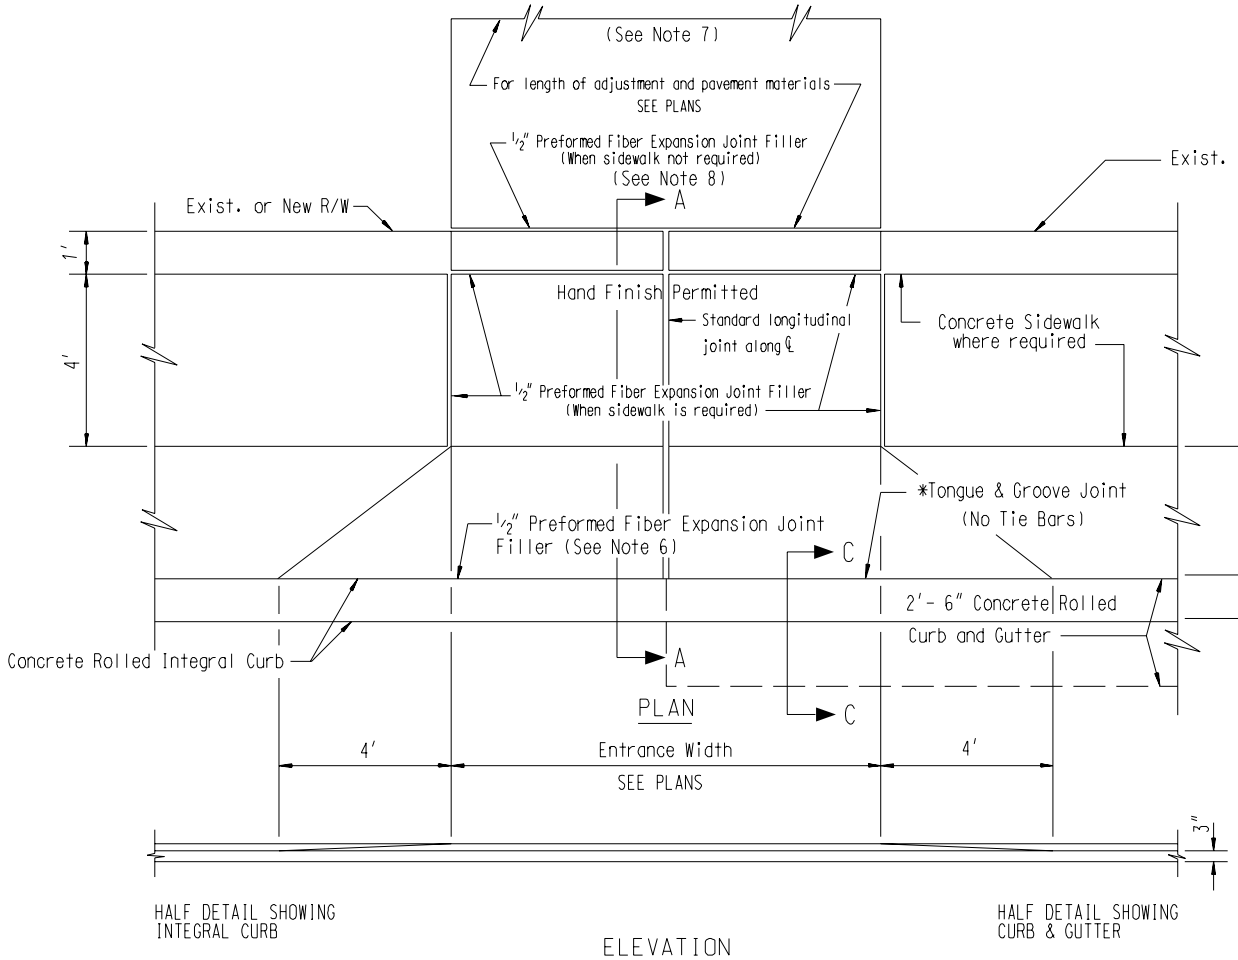

RESIDENTIAL ENTRANCE WITH VERTICAL CURB

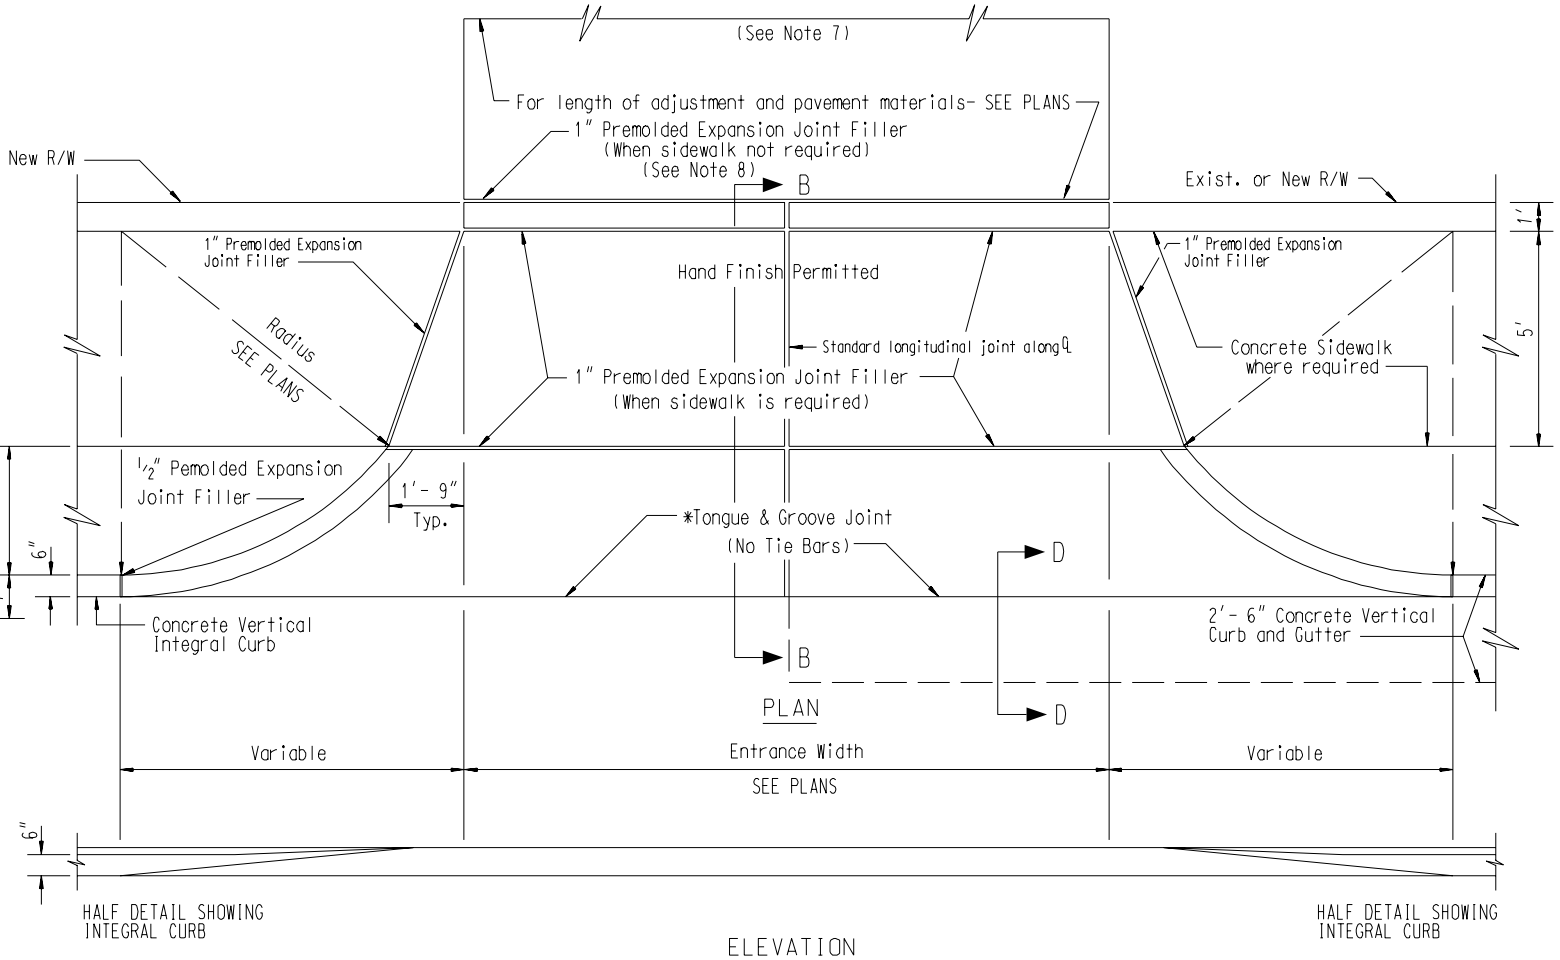

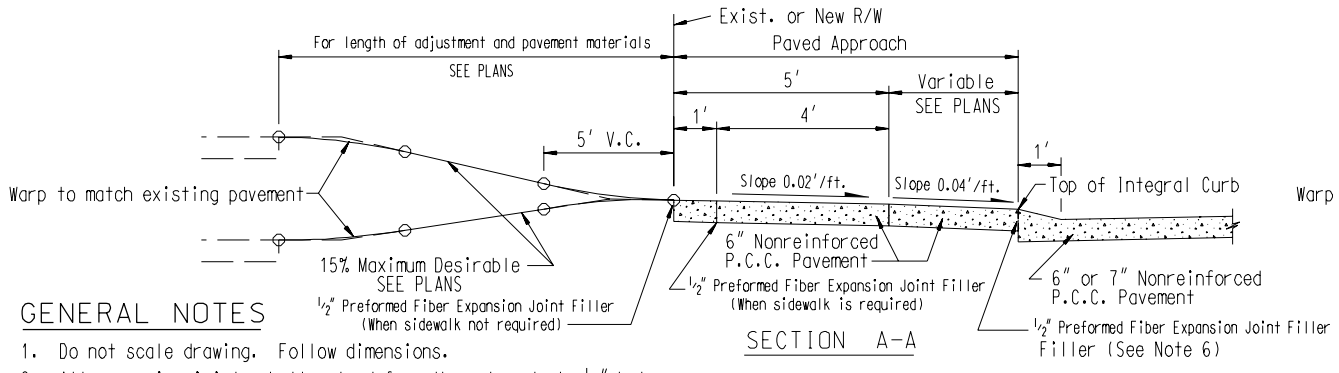

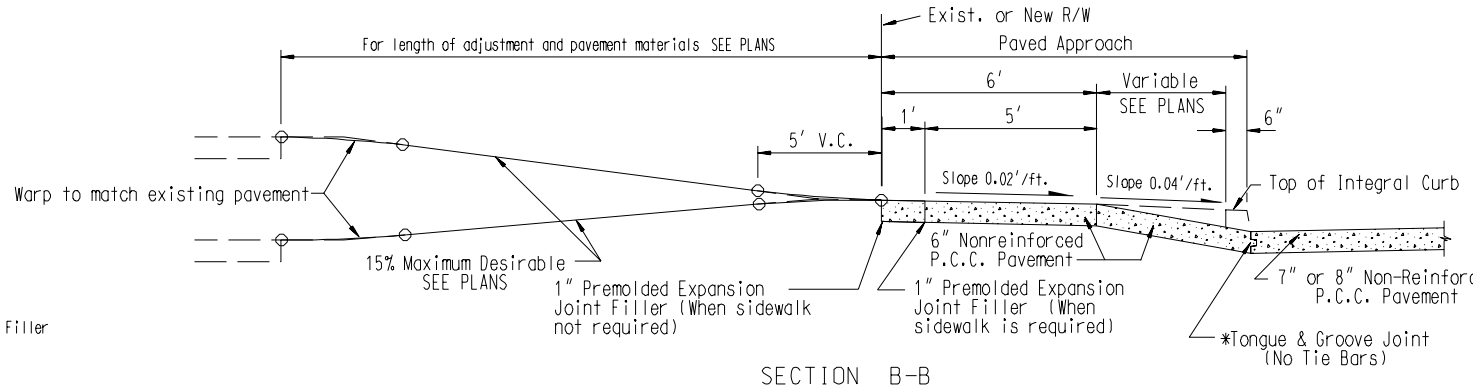

GENERAL NOTES

1. Do not scale drawing. Follow dimensions.
2. All expansion joints shall extend from the subgrade to ½" below top of finished surface of concrete. Joint sealant to conform to Section 1057.13.2 of the Saint Louis County Standard Specifications for highway Construction.
3. Curb and joint dimensions shown in Pavement Construction Details for "Joints and Curbs," Standard Drawing C502.03.
4. The thickness of the first section of sidewalk on each side of the entrance shall be increased to match the driveway approach pavement thickness (6").
5. Joint material shall comply with Standard Specification 1057.2.5 Preformed Fiber Expansion Joint Material (AASHTO M 213).
6. For Construction Details for driveways opposite "T" intersections or on outside of a curve, refer to "Entrance Construction Details, Guidelines for Joint Filler Installation," Std. Dwg. C608.18.
7. ½" Premolded Fiber Expansion Joint Material is required between the garage and the driveway.

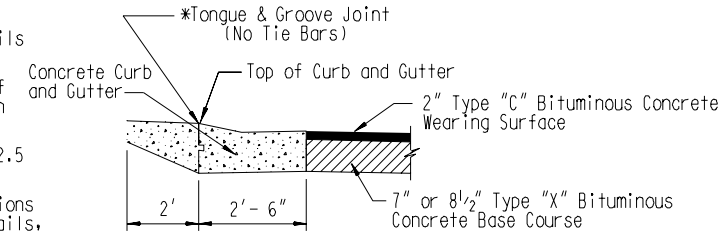

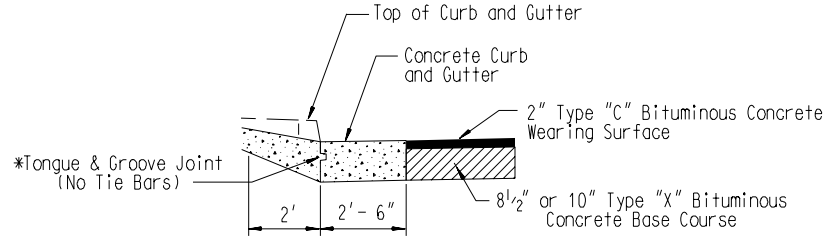

REVISION	
NEW	2-72
	2-78
	4-82
	7-8-88
	3-2-89
	1-11-90
	4-19-93
	10-13-93
	10-13-97
	11-2-98

SAINT LOUIS COUNTY
DEPARTMENT OF HIGHWAYS AND TRAFFIC
CLAYTON, MISSOURI

ENTRANCE CONSTRUCTION DETAILS

RESIDENTIAL CONCRETE ENTRANCES

REVISION DATE: November 2, 1998

DRAWING C608.00